

hexamethyldisilazane in CDCl₃




NAME Jun24-2015
 EXPNO 8
 PROCNO 1
 Date_ 20150624
 Time_ 16.40
 INSTRUM spect
 PROBHD 5 mm QNP 1H/13
 PULPROG zgpg30
 TD 32768
 SOLVENT CDCl₃
 NS 400
 DS 4
 SWH 18248.176 Hz
 FIDRES 0.556890 Hz
 AQ 0.8978932 sec
 RG 23170.5
 DW 27.400 usec
 DE 6.50 usec
 TE 300.0 K
 D1 2.00000000 sec
 D11 0.03000000 sec
 TD0 1

===== CHANNEL f1 =====
 NUC1 13C
 P1 17.70 usec
 PL1 -2.00 dB
 SFO1 75.5082390 MHz

===== CHANNEL f2 =====
 CPDPRG2 waltz16
 NUC2 1H
 PCPD2 80.00 usec
 PL2 0.00 dB
 PL12 16.85 dB
 PL13 60.00 dB
 SFO2 300.2593512 MHz
 SI 16384
 SF 75.5000907 MHz
 WDW EM
 SSB 0
 LB 1.20 Hz
 GB 0
 PC 1.40

75.28
74.85
74.43

0.74
0.37
-0.01
-0.18

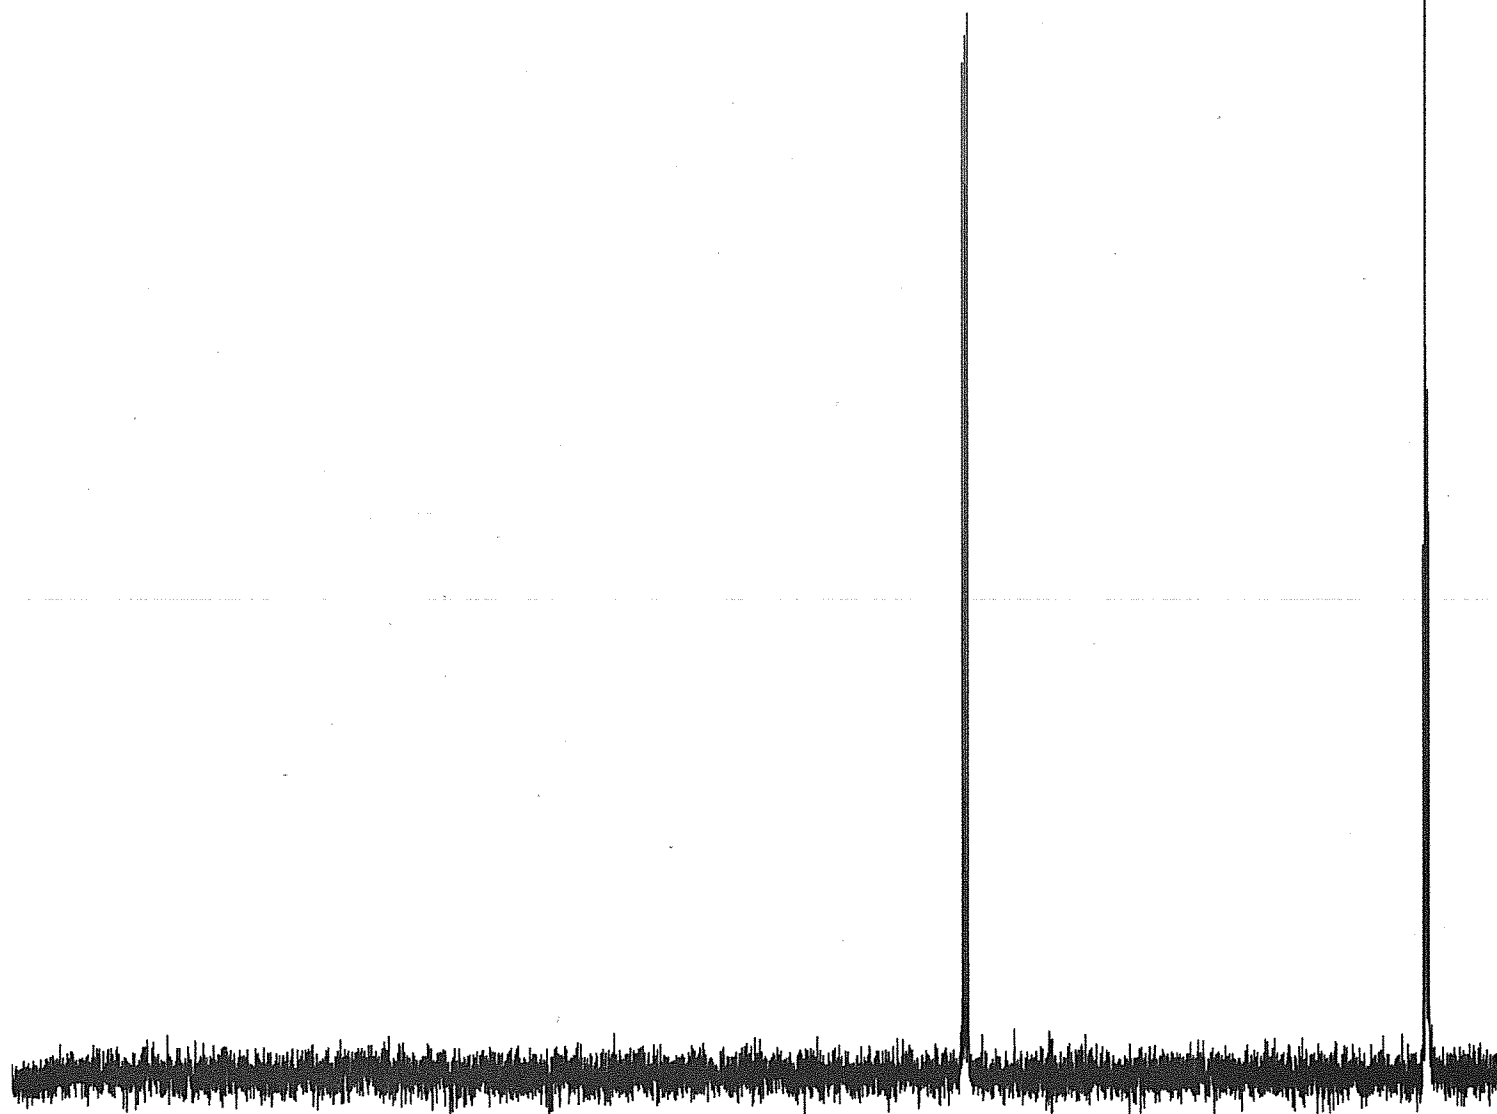

220 210 200 190 180 170 160 150 140 130 120 110 100 90 80 70 60 50 40 30 20 10 0 ppm

Acquisition Time (sec)	0.8978	Comment	hexamethyldisilazane in CDCl ₃	Date	24 Jun 2015 16:40:48
Date Stamp	24 Jun 2015 16:40:48				
File Name	\\netdrive.uvic.ca\SFGClients\Science\Chemistry\UGNMR\data\ugnmruser\nmr\Jun24-2015\8pdata\1\1r	Frequency (MHz)	75.50		
Nucleus	¹³ C	Number of Transients	400	Origin	spect
Owner	ugnmruser	Points Count	16384	Original Points Count	16384
SW(cyclical) (Hz)	18248.18	Pulse Sequence	zgpg30	Receiver Gain	23170.50
Spectrum Type	STANDARD	Solvent	CHLOROFORM-d	Spectrum Offset (Hz)	8148.3022
		Sweep Width (Hz)	18247.06	Temperature (degree C)	27.000

