


N,N-dimethylbenzylamine in CDCl<sub>3</sub>



NAME May14-2014  
 EXPNO 5  
 PROCNO 1  
 Date 20140514  
 Time 11.26  
 INSTRUM spect  
 PROBHD 5 mm QNP 1H/13  
 PULPROG zg30  
 TD 32768  
 SOLVENT CDCl<sub>3</sub>  
 NS 16  
 DS 2  
 SWH 4901.961 Hz  
 FIDRES 0.149596 Hz  
 AQ 3.3423860 sec  
 RG 40.3  
 DW 102.000 usec  
 DE 6.50 usec  
 TE 673.2 K  
 D1 1.00000000 sec  
 TDO 1

===== CHANNEL f1 =====  
 NUC1 1H  
 P1 11.50 usec  
 PL1 0.00 dB  
 SFO1 300.2598500 MHz  
 SI 16384  
 SF 300.2580132 MHz  
 WDW EM  
 SSB 0  
 LB 0.25 Hz  
 GB 0  
 PC 1.00

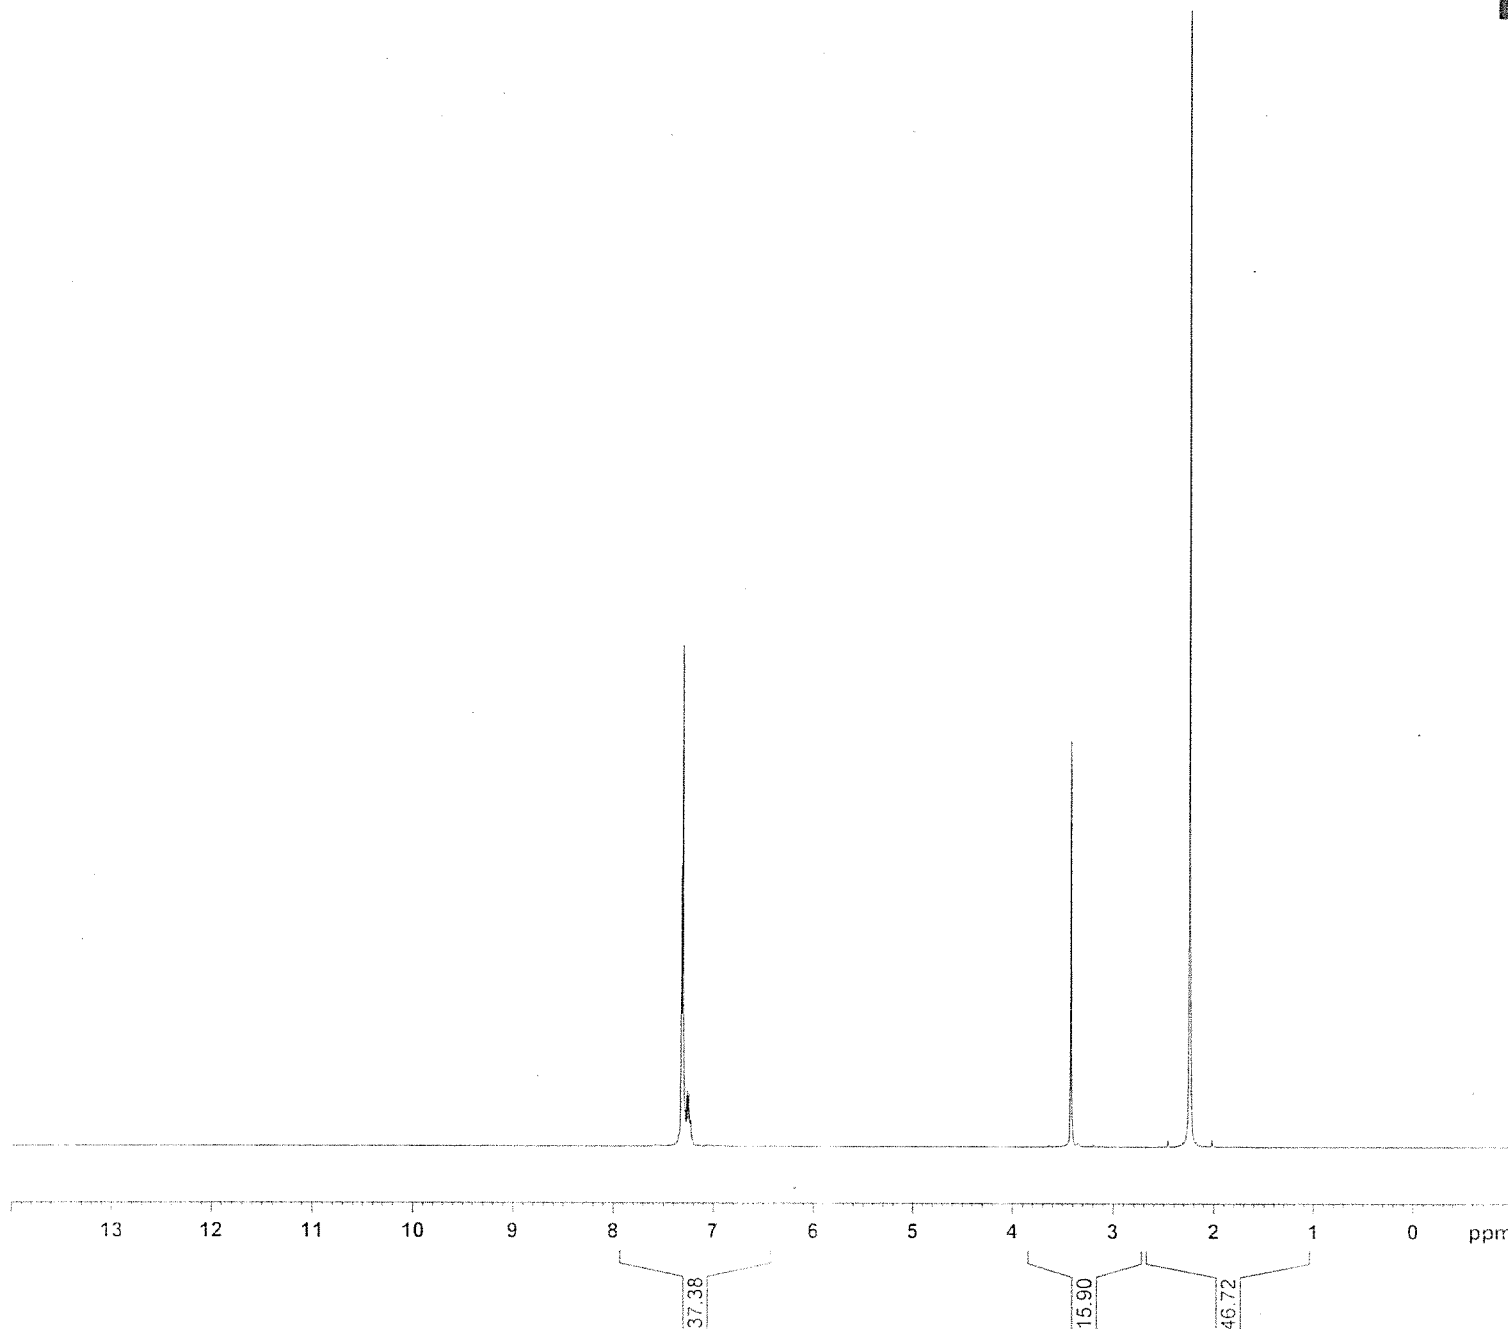

|                        |                                                                                                              |                      |                                  |                      |           |                       |                      |
|------------------------|--------------------------------------------------------------------------------------------------------------|----------------------|----------------------------------|----------------------|-----------|-----------------------|----------------------|
| Acquisition Time (sec) | 3.3423                                                                                                       | Comment              | N,N-dimethylbenzylamine in CDCl3 |                      |           | Date                  | 14 May 2014 11:27:12 |
| Date Stamp             | 14 May 2014 11:27:12                                                                                         |                      |                                  |                      |           |                       |                      |
| File Name              | \\netdrive.uvic.ca\\SFGClients\\Science\\Chemistry\\UGNMR\\data\\ugnmruser\\nmr\\May14-2014\\5\\pdata\\1\\1r |                      |                                  |                      |           | Frequency (MHz)       | 300.26               |
| Nucleus                | 1H                                                                                                           | Number of Transients | 16                               | Origin               | spect     | Original Points Count | 16384                |
| Owner                  | ugnmruser                                                                                                    | Points Count         | 16384                            | Pulse Sequence       | zg30      | Receiver Gain         | 40.30                |
| SW(cyclical) (Hz)      | 4901.96                                                                                                      | Solvent              | CHLOROFORM-d                     | Spectrum Offset (Hz) | 1836.7882 | Spectrum Type         | STANDARD             |
| Sweep Width (Hz)       | 4901.66                                                                                                      |                      |                                  |                      |           |                       |                      |

